



SECTION A-A

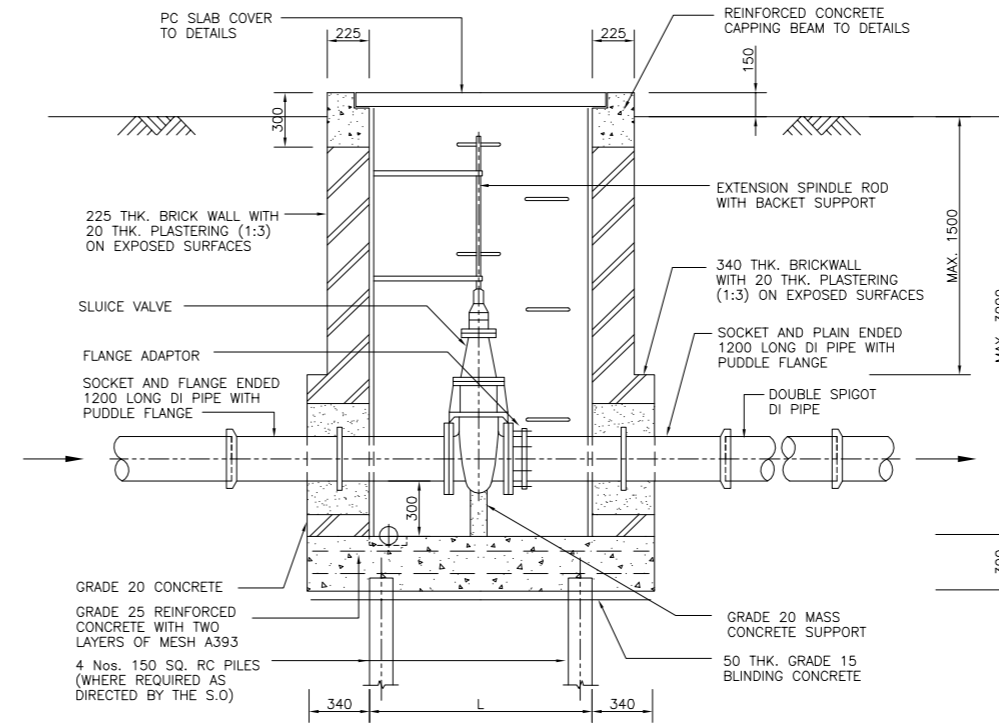


SECTION B-B

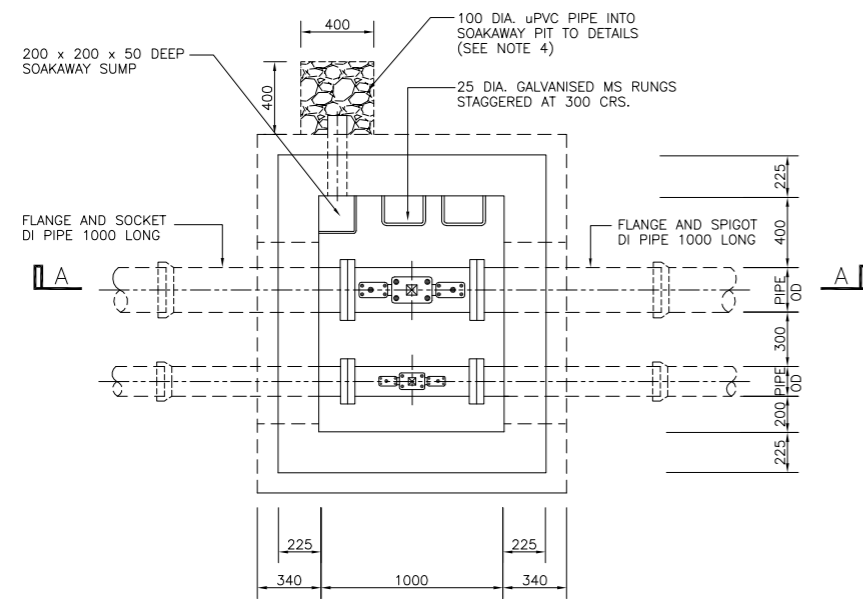

PLAN

DOUBLE ORIFICE AIR VALVE BRICKWALL CHAMBER WITH TWIN DI PIPES ARRANGEMENT

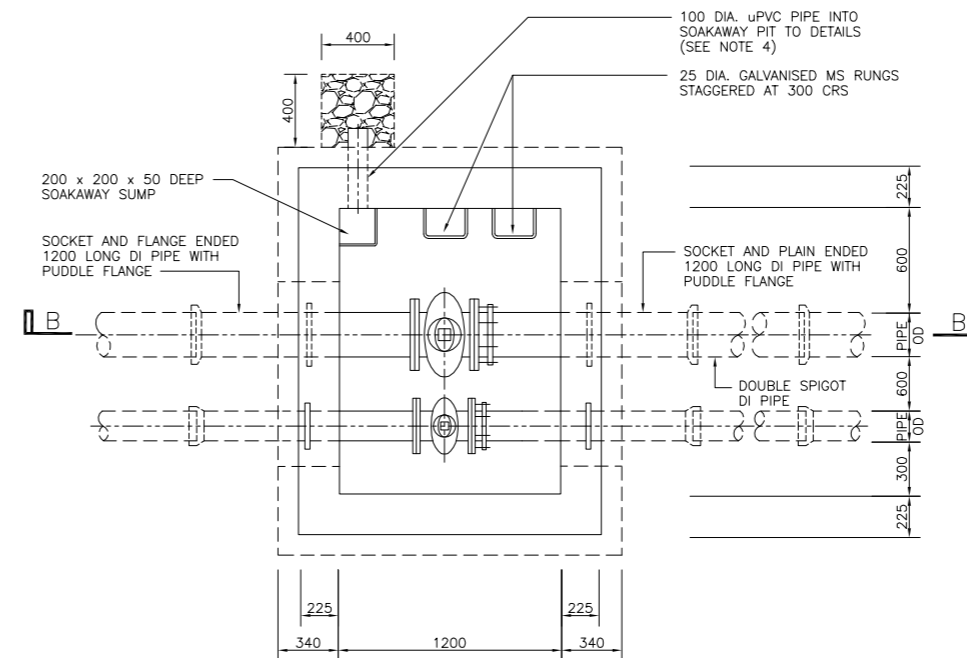

PLAN

SLUICE VALVE BRICKWALL CHAMBER WITH TWIN DI PIPES ARRANGEMENT

- NOTE:
- 1) ALL DIMENSIONS ARE IN MILLIMETRE AND LEVELS IN METRE UNLESS OTHERWISE STATED.
  - 2) ALL CONCRETE TO BE GRADE 25 UNLESS OTHERWISE STATED.
  - 3) ALL GRAVEL SOAKAWAY TO BE WRAPPED WITH TWO LAYERS OF APPROVED FILTER CLOTH.
  - 4) THE uPVC DRAIN AND SOAKAWAY SHALL ONLY BE PROVIDED IF THE GROUND WATER TABLE IS LOWER THAN THE INVERT LEVEL OF THE CHAMBER AS DIRECTED BY THE S.O
  - 5) FOR DETAIL OF PC SLAB COVER AND CAPPING BEAM, REFER DRG. No. SAJH / SD / ch / 01

| REV. | REVISED BY | DESCRIPTION | DATE     |
|------|------------|-------------|----------|
| 01   | NORAZLIN   | CHANGE LOGO | JAN 2018 |
|      |            |             |          |
|      |            |             |          |
|      |            |             |          |
|      |            |             |          |
|      |            |             |          |
|      |            |             |          |
|      |            |             |          |
|      |            |             |          |



**Ranhill SAJ**  
**SAJ Ranhill Sdn. Bhd.** (476718-H)  
 Jalan Garuda, Larkin, P.O Box 262,  
 80350 Johor Bahru, Johor, Malaysia  
 T\_+607 - 224 4040 F\_+607 - 224 0033  
 1800-88-7474 sms 019-772 7474 www.sajranhill.com.my customer.care@saj.com.my

PROJECT :

DRAWING TITLE :  
 DETAILS OF AIR VALVE AND SLUICE VALVE BRICKWALL CHAMBER FOR TWIN PIPES

|                                 |                 |
|---------------------------------|-----------------|
| DRAWN BY : MAZZ                 | DESIGNED : W.C  |
| CHECKED : MFB                   | APPROVED : T.C  |
| SCALE : NOT TO SCALE            | DATE : JAN 2018 |
| DRAWING NO : SAJ/STD/CH/12 (01) |                 |